


75mm LAYER OF COMPACTED
20mm CLASS 3 FCR BEDDING

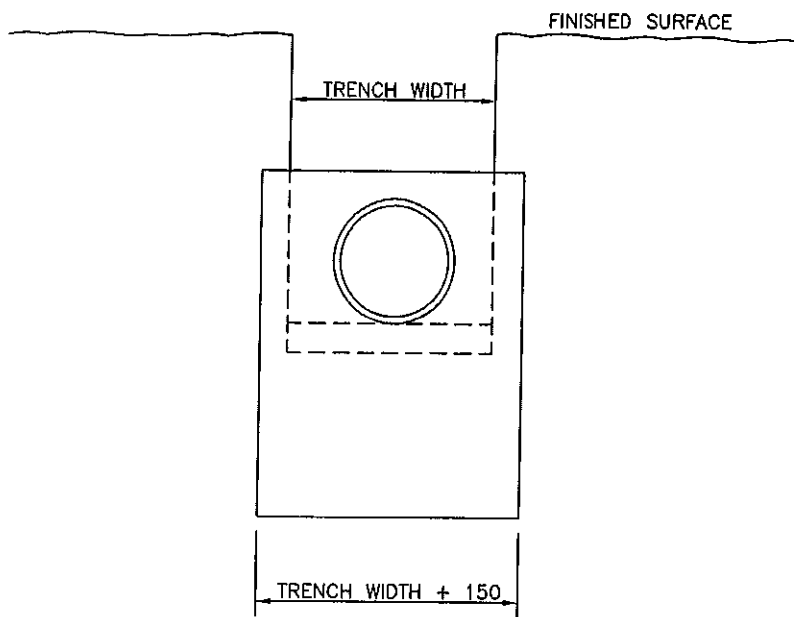

SECTION A-A

NOTES:

1. DRAINAGE LINES REQUIRING ANCHOR BLOCKS SHALL COMPRISE RUBBER RING JOINTED PIPES.
2. ANCHOR BLOCKS TO BE PLACED AT A MAXIMUM SPACING OF FOUR PIPE LENGTHS (9.76m) IN DRAINAGE LINES STEEPER THAN 1:10 OR AS SPECIFIED.



ANCHOR BLOCK FOR REINFORCED CONCRETE PIPE

APPROVED

Savvi
MANAGER
ENGINEERING SERVICES

DRAWN: M BASILE

CHECKED: S.Q

AMENDMENTS: APRIL 2011

SCALE: 1:20

DATE: MAY 2011

BY: M BASILE

DRAWING No.

S120